


Körnungslinie nach DIN 18 123



Signatur	Aufschluss:	Tiefe:	U/Cc	T / U / S / G [%]:	d 10	d 15	d 30	d 50	d 60	Ingenieurgesellschaft Kärcher mbH Heidengass 16 76356 Weingarten Tel.: 07244 / 7013-0 Fax: 7013-17 BV HWS NSG Bruch Ubstadt - Weiher Projekt-Nr.: E 8220 D Datum: 05.07.2021 Bearbeiter: Gh / Ka Anlage: 3.11			
————	Schlammprofil 2	Ufer	4.6/2.9	3.2/74.0/22.8/ -	0.0117	0.0294	0.0423	0.0496	0.0535				
-----	Schlammprofil 3	Ufer	5.4/3.4	3.4/66.4/30.2/ -	0.0110	0.0325	0.0470	0.0561	0.0597				
-.-.-.-.-	Schlammprofil 4	Ufer	1.7/1.2	0.2/99.8/ - / -	0.0285	0.0325	0.0400	0.0458	0.0481				
.....	Schlammprofil 6	Ufer	-/-	0.2/99.8/ - / -	0.0453	-	-	-	-				

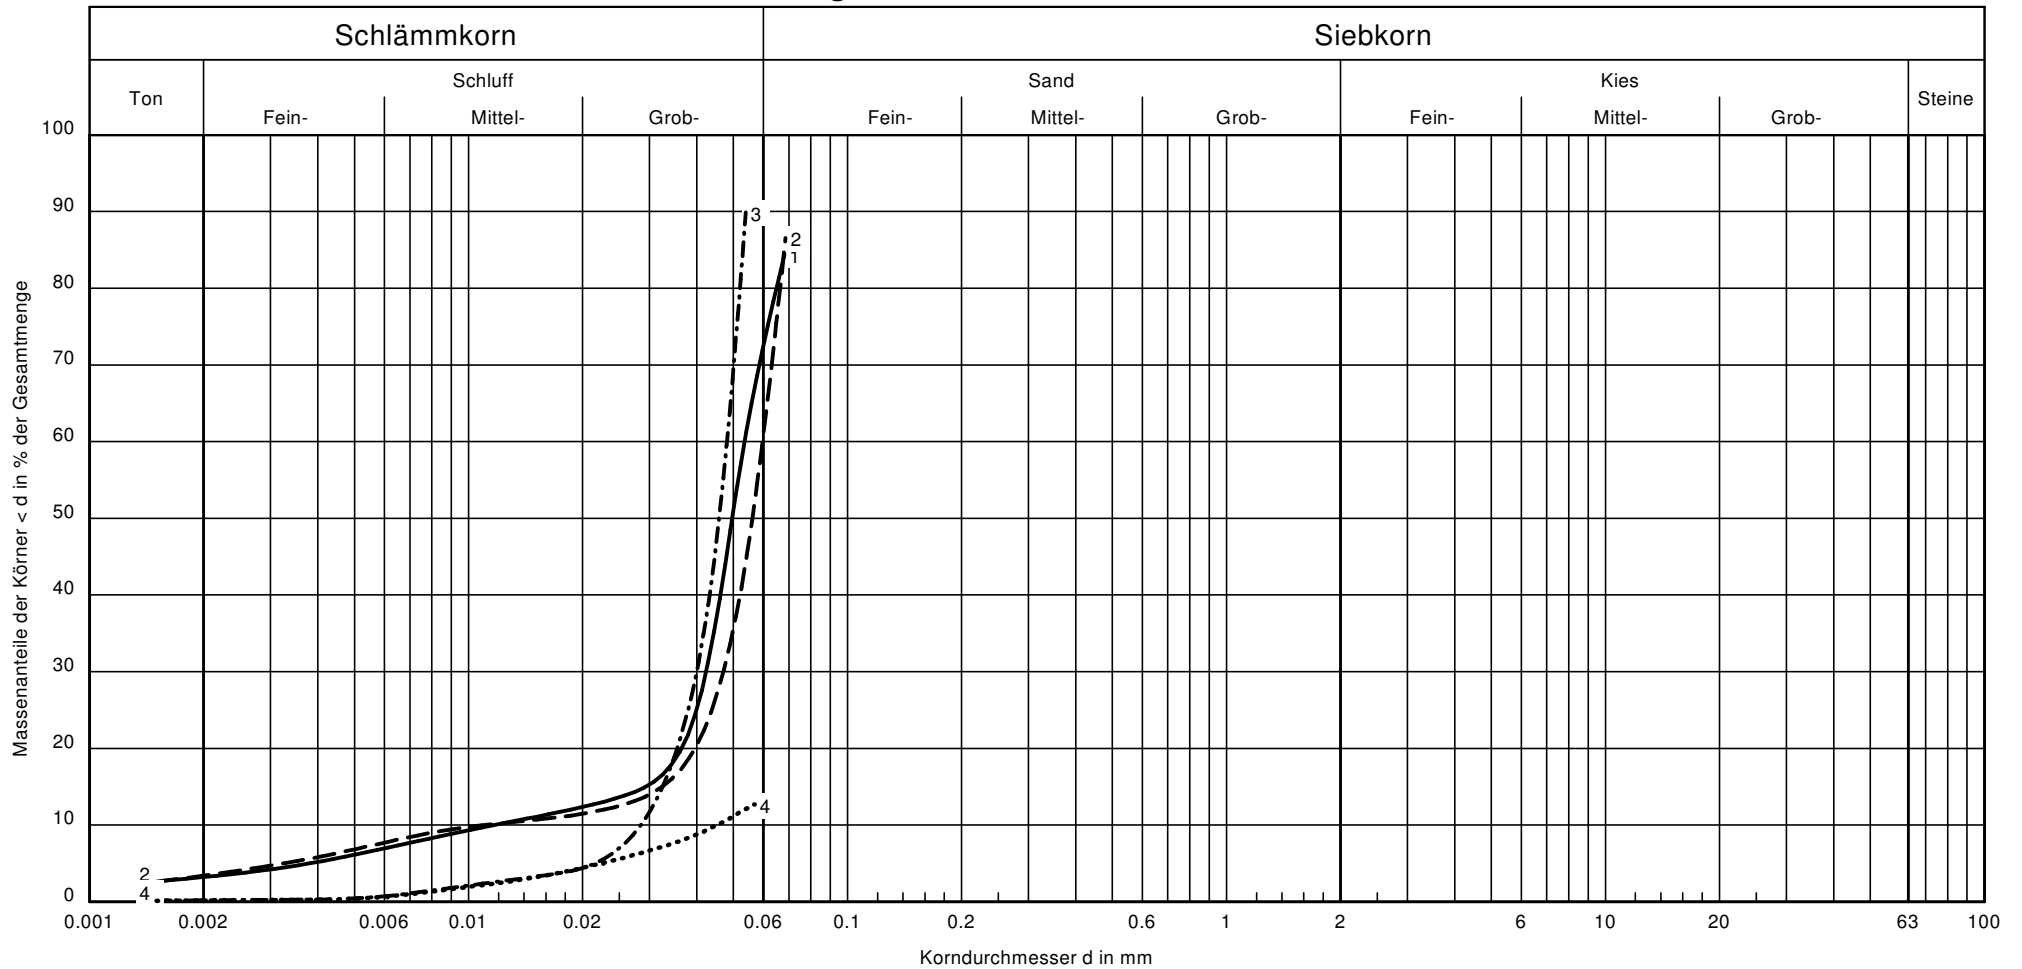