


Körnungslinie nach DIN 18 123

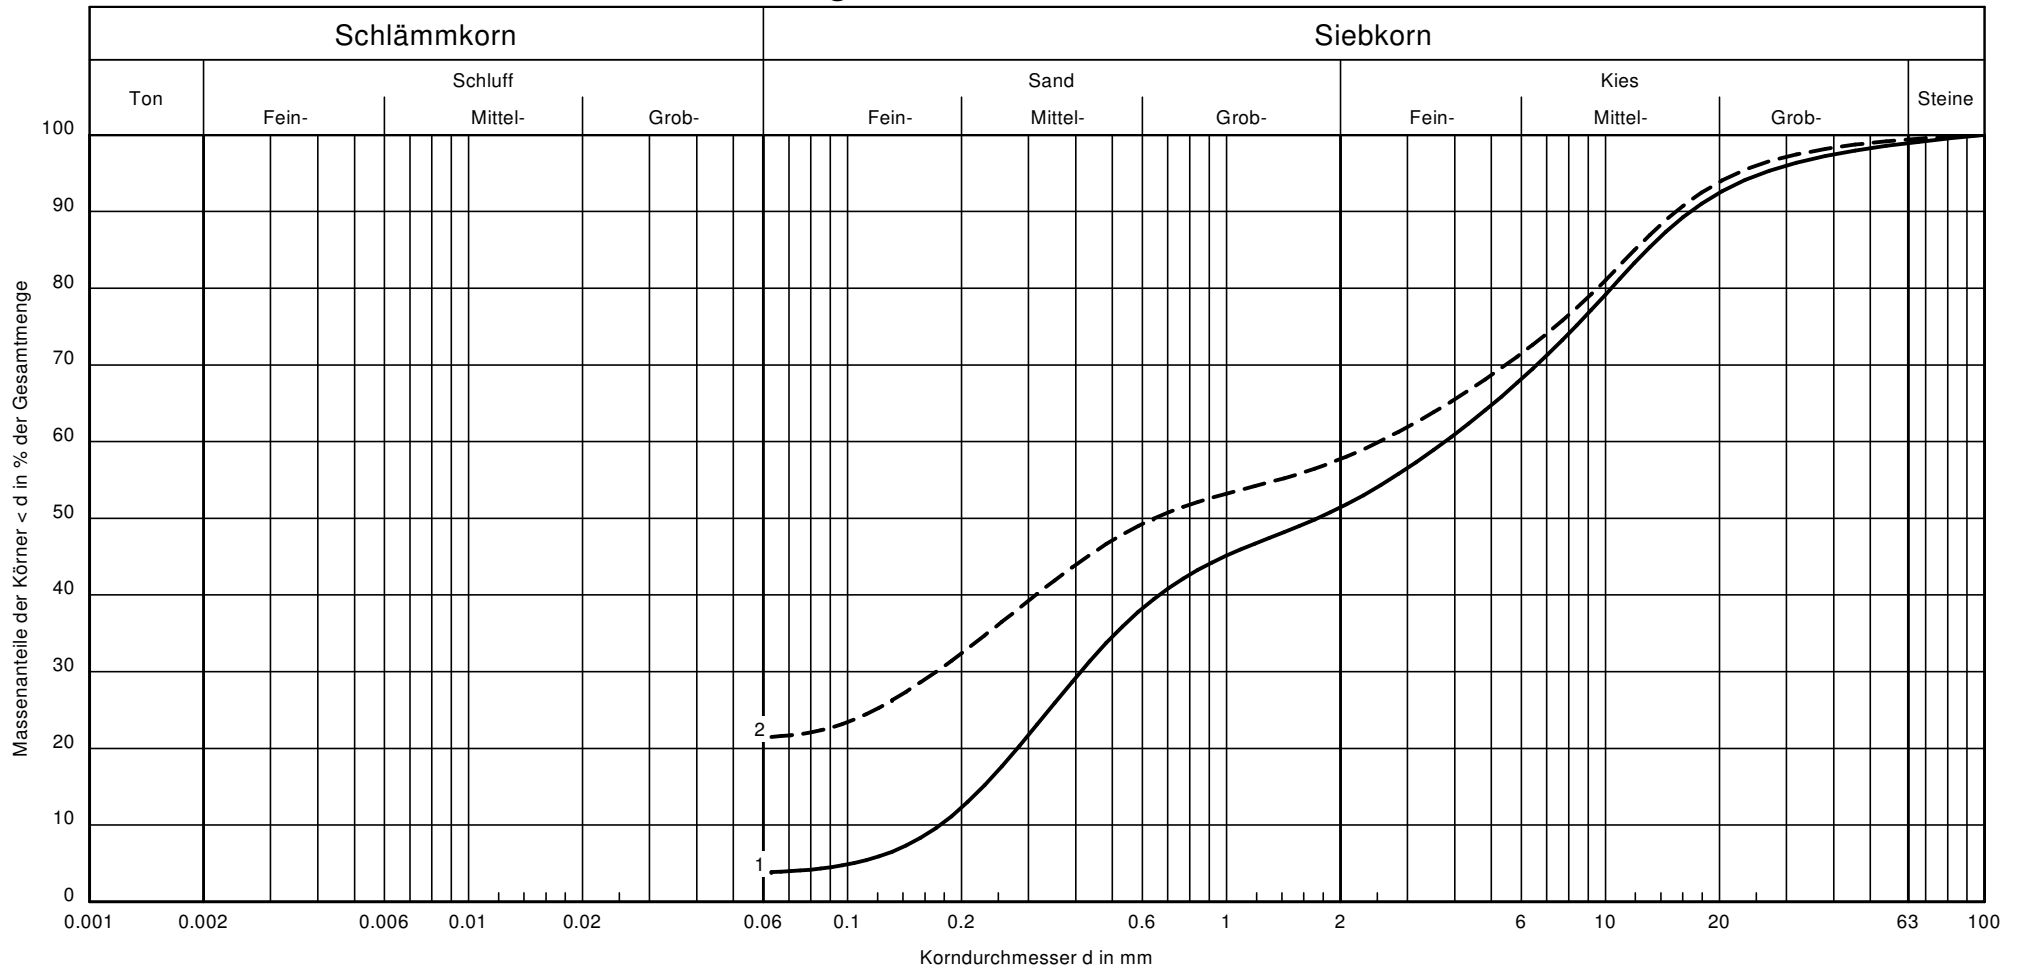

Signatur	Aufschluss:	Tiefe:	Bodenart:	U/Cc	T / U / S / G [%]:	d 10	d 15	d 30	d 50	d 60	Ingenieurgesellschaft Kärcher mbH Heidengass 16 76356 Weingarten Tel.: 07244 / 7013-0 Fax: 7013-17			
—	RKS 21b	3,5 - 5,5		21.5/0.3	- /3.9/47.5/47.5	0.1755	0.2280	0.4133	1.7402	3.7755				
----	RKS 23b	3,5 - 5,0		-/-	- /21.5/36.2/41.7	-	-	0.1714	0.6459	2.5327	BV Kraichbach Ubstadt - Weiher			
											Projekt-Nr.:	Datum:	Bearbeiter:	Anlage:
											E 8220 D	05.07.2021	Gh / Ka	3.9